




*Life Safety
Made Simple*

Annual Fire Pump Inspection NFPA 25 8.1

- Sales
- Estimating
- Design
- Installation
- Inspections
- 24 Hour Emergency Service & Repair

- Fire Alarm
- Monitoring
- Security
- Fire Sprinkler & Suppression Systems

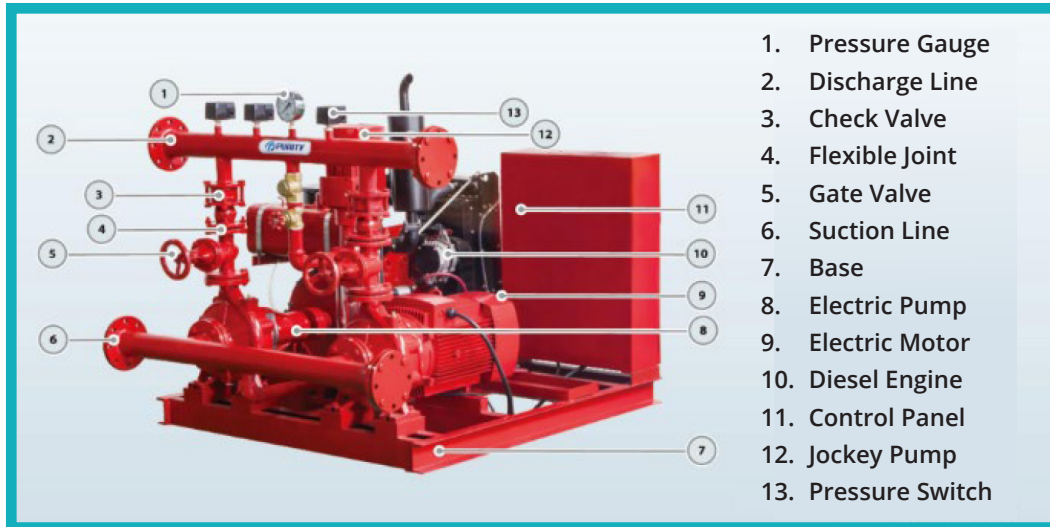

A requirement of NFPA 25, 8.1 (the standard for fire sprinkler inspections) is that every year you are also required to have a licensed contractor conduct an annual inspection and test of your fire sprinkler pump and jockey pump.

This test inspection/Test covers the following:

- The pump has been inspected and tested according to the manufacturer's specifications.
- The Fire Pump and Jockey Pump components are inspected, tested and maintained.
- The Fire Pump and Jockey Pump are tested to ensure that the Fire Pump and Jockey Pump perform to the original manufacturers design specifications.
- The Fire Pump is tested at Churn (No Flow), 100% Capacity and 150% capacity.

Brothers Fire & Security can provide you all necessary labor and materials to perform this inspection for you. Contact one of our sales reps today.