



214 Industrial Lane  
Alum Bank, PA 15221  
888.274.7855  
[www.creativepultrusions.com](http://www.creativepultrusions.com)

Prepared by:

**Dustin Troutman**

*Director of Marketing &  
Product Development*

**Jeremy Mostoller**

*Product Design Engineer*

February 27, 2014

## 5<sup>th</sup> Percentile Strength Values Development

In Support of the Creative Pultrusions, Inc.  
Composite Utility Poles Brochure



---

Download the Composite Utility Poles Brochure:

[www.creativepultrusions.com/pultrudedsystems/composite-utility-poles/](http://www.creativepultrusions.com/pultrudedsystems/composite-utility-poles/)

---

## Introduction

In 2007, the National Electric Safety Code (NESC) Standards Committee adopted composite poles, crossarms and braces into the code. This action was a significant step in terms of mandating that the composite electrical structures manufacturing industry publish the design strength values to a 5% lower exclusion limit. This action forces all utilities that are designing with the NESC code to require manufactures to publish their design values based on 5<sup>th</sup> percentile strength factors. This paper describes the test, test set up, statistical calculations and relevant standards that were used to generate 5<sup>th</sup> percentile strength values as published in the Creative Pultrusions, Inc. Composite Utility Poles Product Brochure.

## Investigation

The following physical characteristics were evaluated in order to obtain the 5<sup>th</sup> percentile strength values for design purposes:

- Flexural and Compression Bending Strength per ASTM D1036
- Moment Capacity per ASTM D1036
- Modulus of Elasticity per ASTM D1036
- Axial Compression Strength
- Pole Torque Strength
- Pin Bearing Strength in the Lengthwise and Crosswise Direction of the Pole
- Washer Pull Through Strength
- Shear Strength
- In-plane Shear Strength per ASTM D5379

## Experiment

### **Moment Capacity, Flexural and Compression Bending Strengths and Modulus of Elasticity**

The moment capacity and flexural and compression bending strengths were calculated based on the 5<sup>th</sup> percentile strength of the poles when tested in full section to ASTM D1036 Standard Test Methods of Static Tests of Wood Poles. The cantilever method for determining bending strength and stiffness was utilized. Tests were conducted by EDM International, Fort Collins, CO., and by Creative Pultrusions, Inc., Alum Bank, PA.



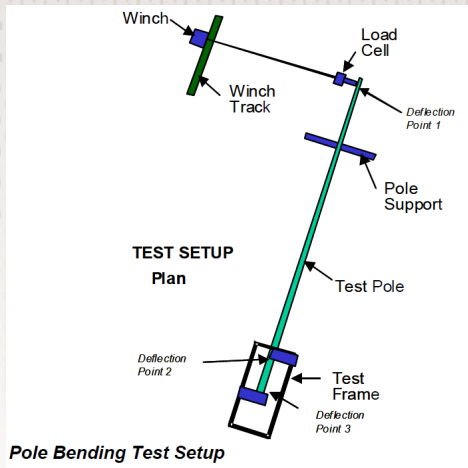


Figure 1

The test involved a horizontal cantilever arrangement with the butt end placed inside a rigid test frame and held in position by 12" wide nylon slings. Rigid horizontal support beams were used to support the dead weight of the pole. The load cable was attached approximately two feet from the pole tip using a nylon strap. Load was applied at a constant rate of deformation until failure using a winch. The winch was mounted on a trolley that moved along a track to keep the load perpendicular to the original pole axis. Creative's and EDM's test facilities are equipped with a pole holding fixture, loading system, electronic load and deflection measuring sensors, and a computerized data acquisition system. The calibrated S load cell has an accuracy of  $\pm 6$  lb., while the calibrated string pot has an accuracy of  $\pm 1/16$ ".



Transverse Pin Bearing Strength



Lengthwise Pin Bearing Strength

## Pin Bearing Strength

Two holes were drilled through short sections of both the round and octagonal poles. Either a 1" diameter or  $3/4$ " diameter pin was placed through the pole. A load was applied at a steady rate through the pin until a pin bearing failure occurred. The failure load is defined as the first decrease in load when observing the load/deflection graphs. The test was conducted in both the lengthwise and transverse directions of the pole. The Transverse Pin Bearing Strength and Lengthwise Pin Bearing Strength photos depict the test set up. The instrument utilized to test the poles is a calibrated 50 kip flexural test machine located at Creative's facility.



*Washer Push Through Test Set Up*

## **Washer Pull Through Strength**

Washer pull through strengths were determined for both the octagonal and round pultruded poles. The test set up involved a three-foot section of pole, cradled on each end, resulting in a free spanning section of pole with a length of two feet. A hole was drilled through the pole. A bolt was placed through the washer and into the hole. The top of the bolt head was loaded at a steady rate until failure occurred. The data acquisition system logged the load and displacement until failure. The failure load is defined as the first drop in load when observing the load/deflection plots.



*In-plane Shear Strength*

## **In-plane Shear Strength per ASTM D5379**

The in-plane shear strength was determined by ASTM D5379 Standard Test Method for Shear Properties of Composite Materials by the V-Notched Beam Method 1. The coupons were extracted from the octagonal and round poles and prepared per the requirement of ASTM D5379. Tests were conducted on the calibrated Instron 250 kN tensile test machine at Creative's facility.



Local Compression Buckling Failure

## Observations and Results

### Moment Capacity

Octagonal and round poles were tested per ASTM D1036 to failure via the cantilever method. The failure mode was local compression buckling at a position equivalent to several feet above the ground line.

The full section failure load was multiplied by the moment arm of the pole, determined by subtracting the pole length by the sum of 10% of the pole length plus two feet plus an additional two feet, which takes into account the location of the load applied at the top of the pole. The resultant of the failure load times the moment arm equates to the moment at failure.

The moment capacity, derived from full section testing, was then used to predict the strength capacity of the poles at various lengths and loads. The pole load charts were developed based on the failure moments of tested poles. The failure moments of the tested poles were used to develop the pole load charts. The following charts summarize the octagonal and round pole test data.

| Pole Moment Capacity and Modulus of Elasticity per ASTM D1036 |                              | Octagonal Pole CP076 8" | Octagonal Pole CP074 10" | Octagonal Pole CP210 10" |
|---|------------------------------|-------------------------|--------------------------|--------------------------|
|   | # of Specimens               | 3                       | 5                        | 12                       |
|   | Mean Value lb                | 1,949                   | 2,741                    | 3,371                    |
|   | Standard Deviation           | 52                      | 93                       | 85                       |
|   | COV                          | 2.7%                    | 3.4%                     | 2.5%                     |
|   | 5% LEL                       | 1,863                   | 2,587                    | 3,232                    |
|   | Average Bending Moment lb-ft | 62,368                  | 100,047                  | 123,048                  |
|   | 5% LEL Bending Moment lb-ft  | 59,611                  | 94,437                   | 117,953                  |
|   | Modulus of Elasticity psi    | 4.30E+06                | 4.00E+06                 | 3.70E+06                 |

Table 1 - Octagonal Pole Full Section Testing

| Pole Moment Capacity and Modulus of Elasticity per ASTM D1036 |                              | Round Pole TU455 12"x3/8" | Round Pole TU450 12"x1/2" | Round Pole TU460 16"x1/2" |
|---|------------------------------|---------------------------|---------------------------|---------------------------|
|   | # of Specimens               | 5                         | 3                         | 3                         |
|   | Mean Value lb                | 4,364                     | 5,743                     | 6,748                     |
|   | Standard Deviation           | 183                       | 305                       | 160                       |
|   | COV                          | 4%                        | 5.3%                      | 2.4%                      |
|   | 5% LEL                       | 4,063                     | 5,241                     | 6,485                     |
|   | Average Bending Moment lb-ft | 178,909                   | 262,009                   | 400,368                   |
|   | 5% LEL Bending Moment lb-ft  | 166,593                   | 244,124                   | 388,752                   |
|   | Modulus of Elasticity psi    | 5.10E+06                  | 5.84E+06                  | 5.52E+06                  |

Table 2 - Round Pole Full Section Testing



The data detailed in Tables 1 and 2 describe the number of tests conducted, the average failure load, the standard deviation, coefficient of variation, the average bending moment, the 5<sup>th</sup> lower exclusion limit, and the modulus of elasticity.

The 5<sup>th</sup> percentile strength limits, derived for all of the design values throughout the pole brochure, were derived with the following equation:

5<sup>th</sup> percentile strength limit = mean - 1.645 (mean x COV) in which the COV is the coefficient of variation within the test results.

## Flexural and Compression Bending Strength and Axial Compression

The flexural and compression bending strengths were derived by establishing the compression and flexural stress at failure. The values were realized by dividing the moment by the section modulus of the pole sections.

Because the poles fail in compression, the bending strength is limited to the compression stress at failure. The compression bending strength is conservatively assumed to be the axial compression strength as well. The conservative axial compression strength is used to predict the short column axial compression capacity of the poles.

## Modulus of Elasticity

The average modulus of elasticity for each pole profile was derived by back calculating the modulus from a mechanics of materials beam equation. The constant cross section of the pole simplifies the computations necessary to both predict the deflection of a pultruded pole and to derive the full section modulus of elasticity.

The load vs. deflection data, developed during the ASTM D1036 pole tests, was utilized to back calculate the modulus of elasticity.

---

The modulus of elasticity was derived by the following equation:

$$E = PL^3 / 3\Delta I$$

In which:

**E** = Modulus of Elasticity (psi)

**P** = Load (lb)

**L** = Test Length of Pole (in)

**Δ** = Deflection (in)

**I** = Moment of Inertia (in<sup>4</sup>)

The modulus can be used to predict the serviceability deflection due to P-delta effects, guy loads and wind loading.

---

## Pin Bearing Strength



Typical Pin Bearing Failure

The pin bearing strength was calculated based on the data generated from the full section pin bearing tests. The strength was calculated by dividing the load at failure by the number of through holes, the diameter of the pin, and the nominal wall thickness of the pole. The failure load is the point in the load/displacement graph that depicts the first yield, or drop in load.

The pin bearing mode of failure is not without warning. The glass fibers begin to buckle as the hole elongates and the load begins to decline during the pin bearing failure process.

TU460.379: Lengthwise Bearing Stress vs Pin Displacement, 1" Pin

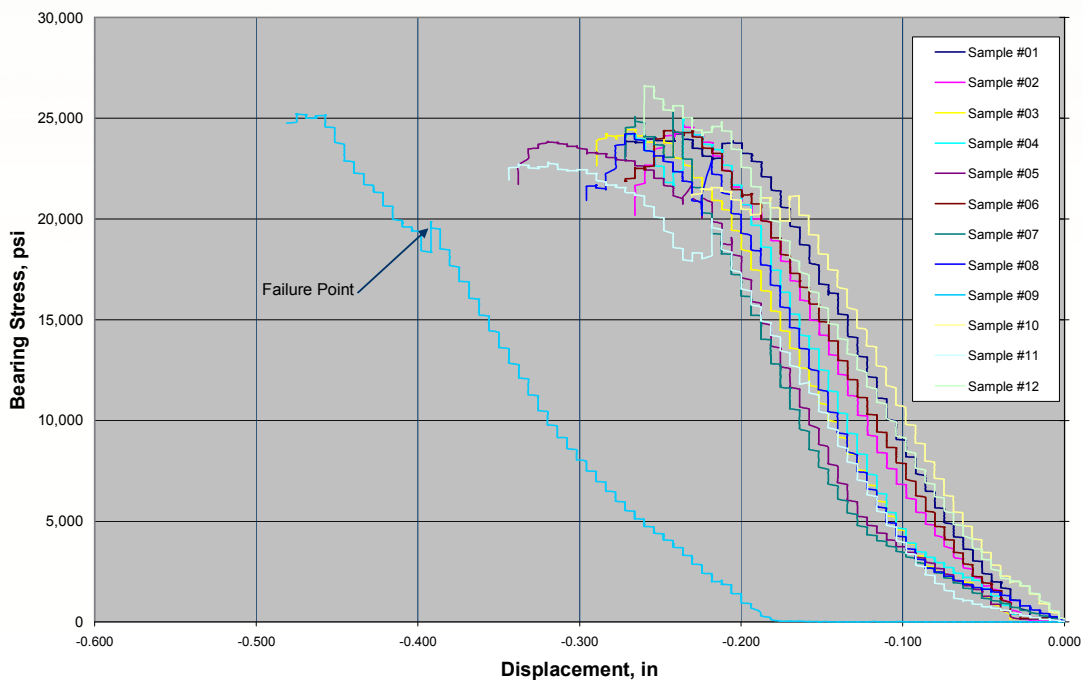


Table 3 – Chart Load vs. Displacement Pin Bearing

The following charts display the number of test performed, the mean value, standard deviation, coefficient of variation and the 5<sup>th</sup> percentile strength values both in terms of the force and resulting stress for both the lengthwise and crosswise pin bearing tests:

|  |                    | Octagonal Pole<br>CP076 8" | Octagonal Pole<br>CP074 10" | Octagonal Pole<br>CP210 10" |
|--|--------------------|----------------------------|-----------------------------|-----------------------------|
| Bearing Load<br>Lengthwise<br>(lb)         | # of Specimens     | 12                         | 15                          | 30                          |
|  | Mean Value         | 10,224                     | 10,584                      | 11,192                      |
|  | Standard Deviation | 1,440                      | 1,111                       | 2,805                       |
|  | COV                | 0.160                      | 0.105                       | 0.258                       |
|  | 5% LEL             | 7,541                      | 8,756                       | 6,434                       |
| Bearing<br>Strength<br>Lengthwise<br>(psi) | # of Specimens     | 12                         | 15                          | 30                          |
|  | Mean Value         | 27,263                     | 28,223                      | 27,132                      |
|  | Standard Deviation | 3,839                      | 2,963                       | 6,799                       |
|  | COV                | 16%                        | 10%                         | 26%                         |
|  | 5% LEL             | 20,110                     | 23,348                      | 15,598                      |

Table 4 - Pin Bearing Results

|   |                    | Octagonal Pole<br>CP076 8" | Octagonal Pole<br>CP074 10" | Octagonal Pole<br>CP210 10" |
|---|--------------------|----------------------------|-----------------------------|-----------------------------|
| Bearing Load<br>Crosswise<br>(lb)         | # of Specimens     | 12                         | 12                          | 11                          |
|   | Mean Value         | 5,759                      | 4,336                       | 4,653                       |
|   | Standard Deviation | 1,005                      | 924                         | 1,088                       |
|   | COV                | 0.201                      | 0.216                       | 0.224                       |
|   | 5% LEL             | 3,856                      | 2,798                       | 2,938                       |
| Bearing<br>Strength<br>Crosswise<br>(psi) | # of Specimens     | 12                         | 12                          | 11                          |
|   | Mean Value         | 15,357                     | 11,562                      | 11,280                      |
|   | Standard Deviation | 2,680                      | 2,465                       | 2,638                       |
|   | COV                | 0.201                      | 0.216                       | 0.224                       |
|   | 5% LEL             | 10,283                     | 7,458                       | 7,123                       |

Table 5 - Pin Bearing Results

|  |                    | Round TU455<br>12x3/8" | Round TU450<br>12"x1/2" | Round TU460<br>16"x1/2" |
|--|--------------------|------------------------|-------------------------|-------------------------|
| Bearing Load<br>Lengthwise<br>(lb)         | # of Specimens     | 12                     | 12                      | 12                      |
|  | Mean Value         | 20,869                 | 29,300                  | 23,065                  |
|  | Standard Deviation | 3,783                  | 2,889                   | 2,035                   |
|  | COV                | 0.159                  | 0.098                   | 0.078                   |
|  | 5% LEL             | 15,415                 | 24,591                  | 20,088                  |
| Bearing<br>Strength<br>Lengthwise<br>(psi) | # of Specimens     | 12                     | 12                      | 12                      |
|  | Mean Value         | 27,826                 | 29,300                  | 23,065                  |
|  | Standard Deviation | 5,043                  | 2,889                   | 2,035                   |
|  | COV                | 16%                    | 10%                     | 8%                      |
|  | 5% LEL             | 20,553                 | 24,585                  | 20,088                  |

Table 6 - Pin Bearing Results



|   |                | Round TU455<br>12x3/8" | Round TU450<br>12"x1/2" | Round TU460<br>16"x1/2" |
|---|----------------|------------------------|-------------------------|-------------------------|
| Bearing Load<br>Crosswise<br>(lb)         | # of Specimens | 12                     | 12                      | 12                      |
|   | Mean Value     | 11,954                 | 17,251                  | 15,393                  |
|   | St. Dev.       | 1,127                  | 2,114                   | 2,152                   |
|   | COV            | 10%                    | 11%                     | 12%                     |
|   | 5% LEL         | 10,059                 | 14,063                  | 12,399                  |
| Bearing<br>Strength<br>Crosswise<br>(psi) | # of Specimens | 12                     | 12                      | 12                      |
|   | Mean Value     | 15,938                 | 17,251                  | 15,393                  |
|   | St. Dev.       | 1,503                  | 2,114                   | 2,152                   |
|   | COV            | 10%                    | 11%                     | 12%                     |
|   | 5% LEL         | 13,412                 | 14,063                  | 12,399                  |

Table 7 - Pin Bearing Results

## Washer Pull Through Strength

The washer pull through results, as depicted in Tables 8 and 9, feature the number of specimens tested, the mean value, the standard deviation, coefficient of variation, and the 5<sup>th</sup> percentile value in terms of load at failure. The failure load is the point in the load/displacement graph that depicts the first yield or drop in load.

|  |                | Octagonal Pole<br>CP076 8" | Octagonal Pole<br>CP074 10" | Octagonal Pole<br>CP210 10" |
|--|----------------|----------------------------|-----------------------------|-----------------------------|
| Washer<br>Push<br>Through (lb)<br>6"x6"x1/2"<br>washer | # of Specimens | 12                         | 10                          | 12                          |
|  | Mean Value     | 13,697                     | 14,698                      | 14,571                      |
|  | St. Dev.       | 1,187                      | 1,035                       | 1,190                       |
|  | COV            | 0.085                      | 0.070                       | 0.074                       |
|  | 5% LEL         | 11,786                     | 13,014                      | 12,802                      |

Table 8 – Washer Pull Through Results

|  |                | Round TU455<br>12x3/8" | Round TU450<br>12"x1/2" | Round TU460<br>16"x1/2" |
|--|----------------|------------------------|-------------------------|-------------------------|
| Washer<br>Push<br>Through (lb)<br>6"x6"x1/2"<br>washer | # of Specimens | 12                     | 12                      | 12                      |
|  | Mean Value     | 17,232                 | 24,663                  | 22,620                  |
|  | St. Dev.       | 935                    | 3,602                   | 1,803                   |
|  | COV            | 6%                     | 14%                     | 0.064                   |
|  | 5% LEL         | 15,528                 | 18,944                  | 20,223                  |

Table 9 – Washer Pull Through Results



*Yielded Steel Washers, Elongated Thimble Eye Nut and Typical Washer Pull Through Failure Mode*

Three failure modes were observed during the washer pull through tests. The 50 ksi steel washers, measuring 6"x6"x1/2", were observed to yield, which resulted in the hollow pole section cracking due to the high stress concentration. The threaded eye nut utility hardware elongated prior to the ultimate load being obtained. This spurred a change in the test set up in which the force was changed from a tension to compression. The applied load was induced into the pole through the hardware bolt head and washer as detailed in the washer pull through test set up photograph.

### **In-plane Shear Strength per ASTM D5379**

The In-plane shear results, as demonstrated in Table 10 for the 12"x1/2" round pole, contains the mean, standard deviation, coefficient of variation, and the 5<sup>th</sup> percentile shear strength values.

| TU450.379 IPS by ASTM D5379 |                          |
|-----------------------------|--------------------------|
| Sample #                    | Ultimate IPS Stress, psi |
| 1                           | 10,501                   |
| 2                           | 11,870                   |
| 3                           | 11,629                   |
| 4                           | 8,684                    |
| 5                           | 12,087                   |
| 6                           | 11,455                   |
| 7                           | 10,850                   |
| 8                           | 11,901                   |
| 9                           | 12,286                   |
| 10                          | 9,306                    |
| 11                          | 11,754                   |
| 12                          | 12,825                   |
|                             |                          |
| # of Specimens              | 12                       |
| Mean Value                  | 11,262                   |
| St. Dev.                    | 1,228                    |
| COV                         | 9.2%                     |
| 5% LEL                      | 9,550                    |

*Table 10 – In Plane Shear Results*

## Pole Torque Strength

The pole torque strength was determined utilizing the 5<sup>th</sup> percentile in-plane shear strength determined via ASTM D5379. Referencing P.K. Mallick Fiber Reinforced Composites Materials, Manufacturing and Design, second edition, Design of Torsional Members, the following relationship exists between the in-plane shear strength, torque, geometry and thickness of the part:

$$\text{Torque} = t_{xy} * 2 * \pi * r^2 * t$$

**Where:**  $t_{xy}$  = in-plane shear strength (psi)  
 $r$  = mean radius (in)  
 $t$  = wall thickness (in)

Example calculation of the 12"x1/2" pole 5<sup>th</sup> percentile torque strength:

$$\text{Torque} = 9,550 \text{ psi} * 2 * \pi * (5.75)^2 * .5 = 991,948 \text{ lb-in}$$

or 82,662 lb-ft

## Shear Strength

The ultimate design shear capacity of the pole was calculated utilizing the 5<sup>th</sup> percentile in-plane shear strength. The shear capacity of the 12" x1/2" round pole was calculated using the following equation:

$$V = (t_{xy} * \text{Area}) / 2$$

**Where:**  $t_{xy}$  = 9,550 psi  
 $A$  = Area (in<sup>2</sup>) = 18.1 in<sup>2</sup>  
 $V$  = Shear Strength (lb)

Therefore, the ultimate 5<sup>th</sup> percentile design shear strength equates to: 86,428 lbs.



## Conclusions

The design values, detailed in the Creative Pultrusions, Inc. Composite Utility Poles Electrical Distribution & Transmission brochure, have been derived based on the requirement of the 2007 NESC. The code requires that 5<sup>th</sup> percentile strengths be published for design purposes. CPI has undertaken the task of determining the 5<sup>th</sup> percentile characteristic strengths for each of the design properties below.

- Flexural and Compression Bending Strength per ASTM D1036
- Moment Capacity per ASTM D1036
- Modulus of Elasticity per ASTM D1036
- Axial Compression Strength
- Pole Torque Strength
- Pin Bearing Strength in the Lengthwise and Crosswise Direction of the Pole
- Washer Pull Through Strength
- Shear Strength
- In-plane Shear Strength per ASTM D5379

## Concluding points

- 5<sup>th</sup> Percentile design values have been determined and documented in the Creative Pultrusions, Inc. Composite Utility Poles Electrical Distribution & Transmission brochure.
- The design values are NESC 2007 up through the current compliant.
- The design values should be utilized in conjunction with the load factors detailed in the NESC code.